

This Page Is Inserted by IFW Operations  
and is not a part of the Official Record

## **BEST AVAILABLE IMAGES**

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images may include (but are not limited to):

- BLACK BORDERS
- TEXT CUT OFF AT TOP, BOTTOM OR SIDES
- FADED TEXT
- ILLEGIBLE TEXT
- SKEWED/SLANTED IMAGES
- COLORED PHOTOS
- BLACK OR VERY BLACK AND WHITE DARK PHOTOS
- GRAY SCALE DOCUMENTS

**IMAGES ARE BEST AVAILABLE COPY.**

**As rescanning documents *will not* correct images,  
please do not report the images to the  
Image Problem Mailbox.**

Fig. 1 Anti-Carcinogenic™ Night Light

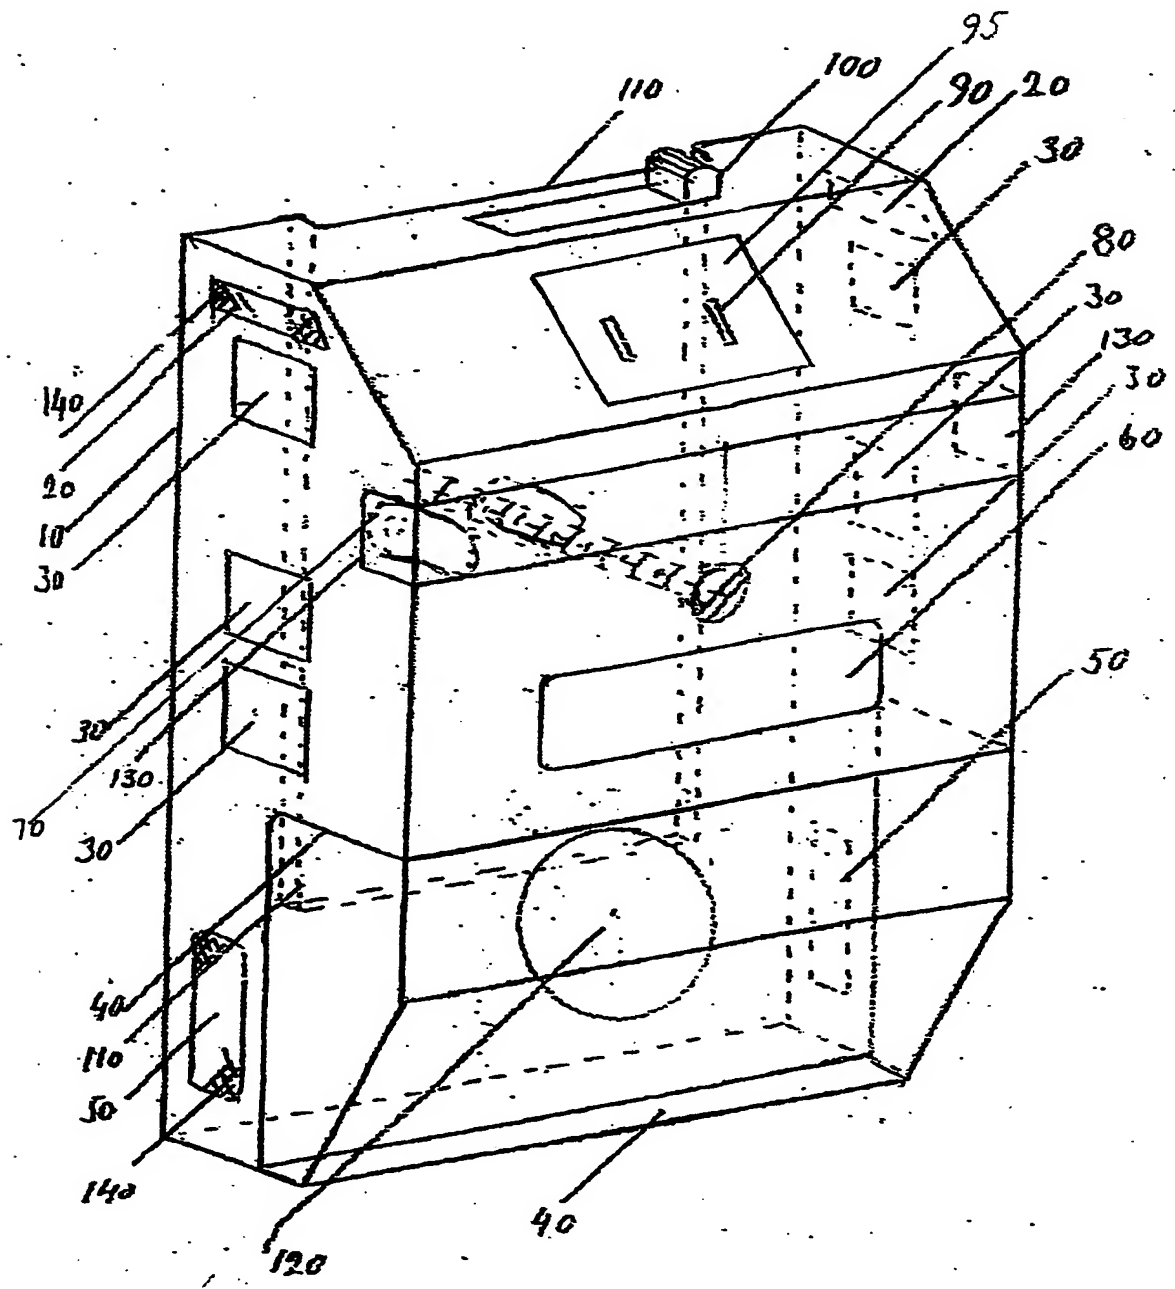


Fig. 2 Electrical Flow Diagram,


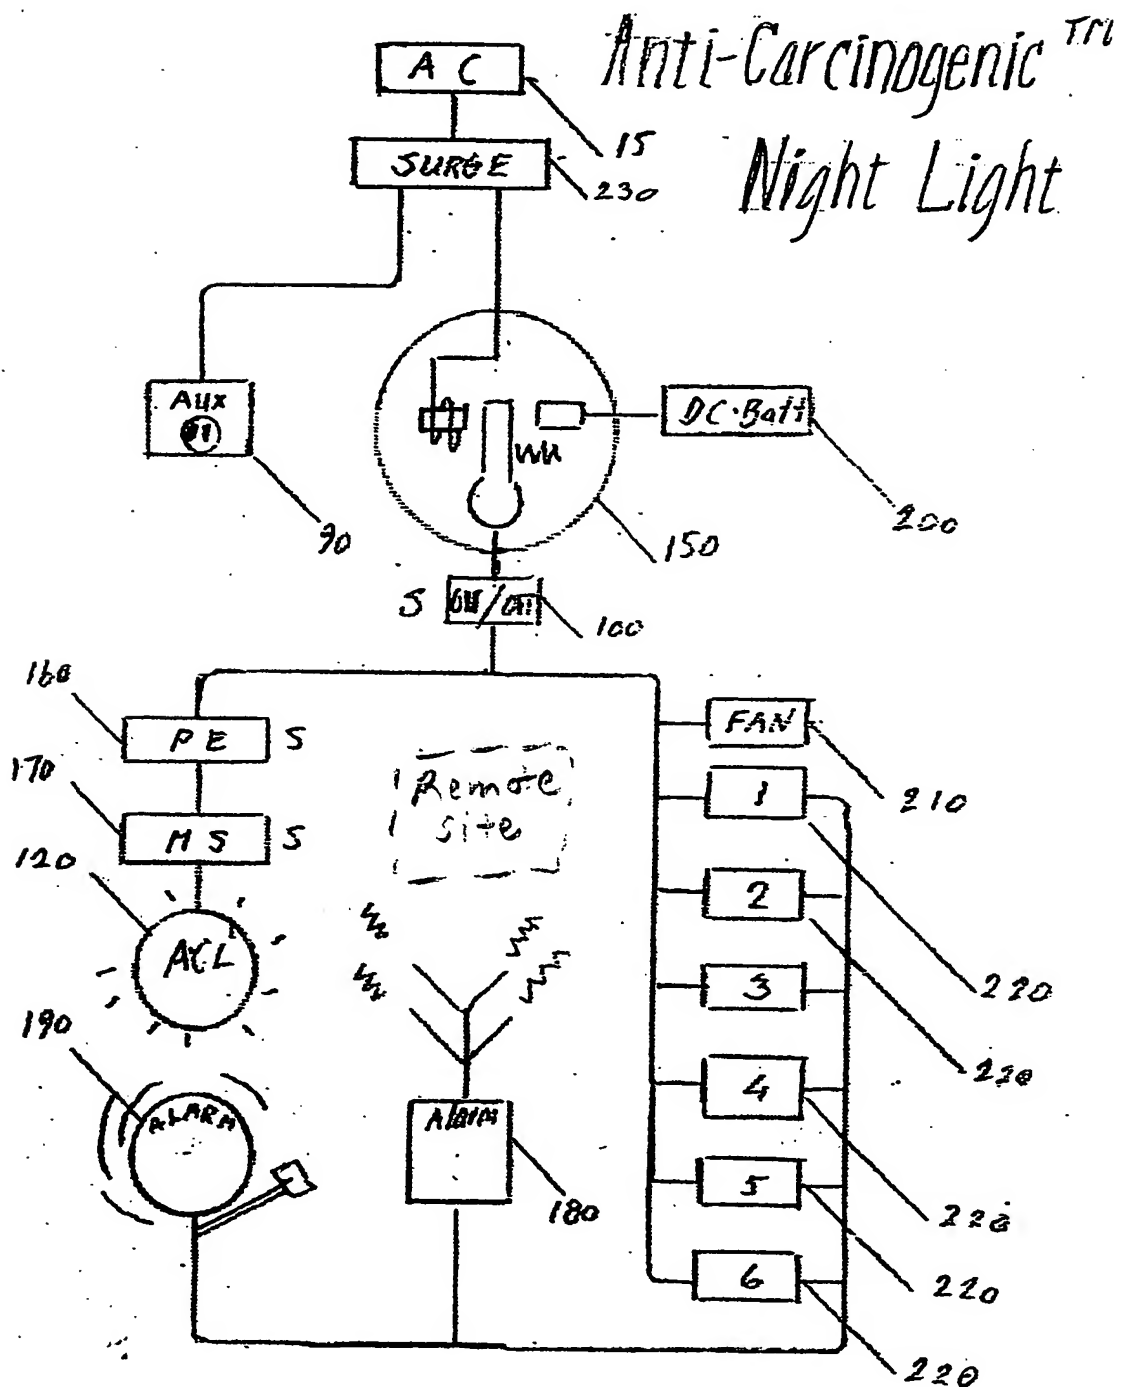


Fig. 3 Flexible Filler Plate

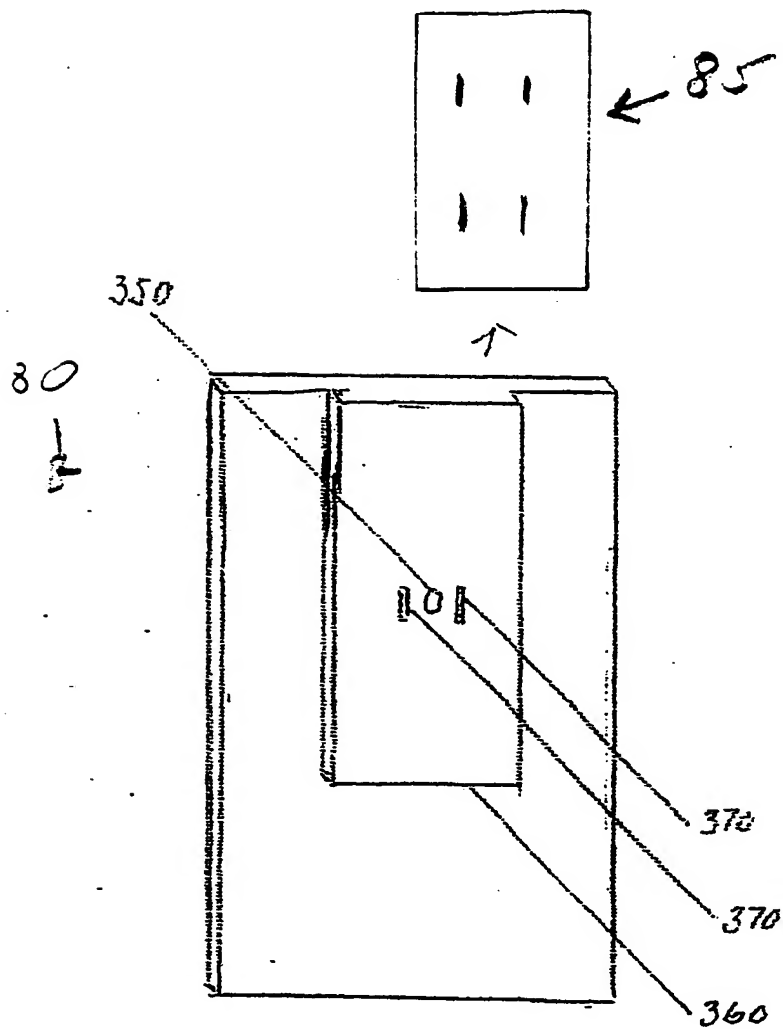

4  
6

Fig. 4 Anti-Carcinogenic™ Refrigerator  
Flow Diagram


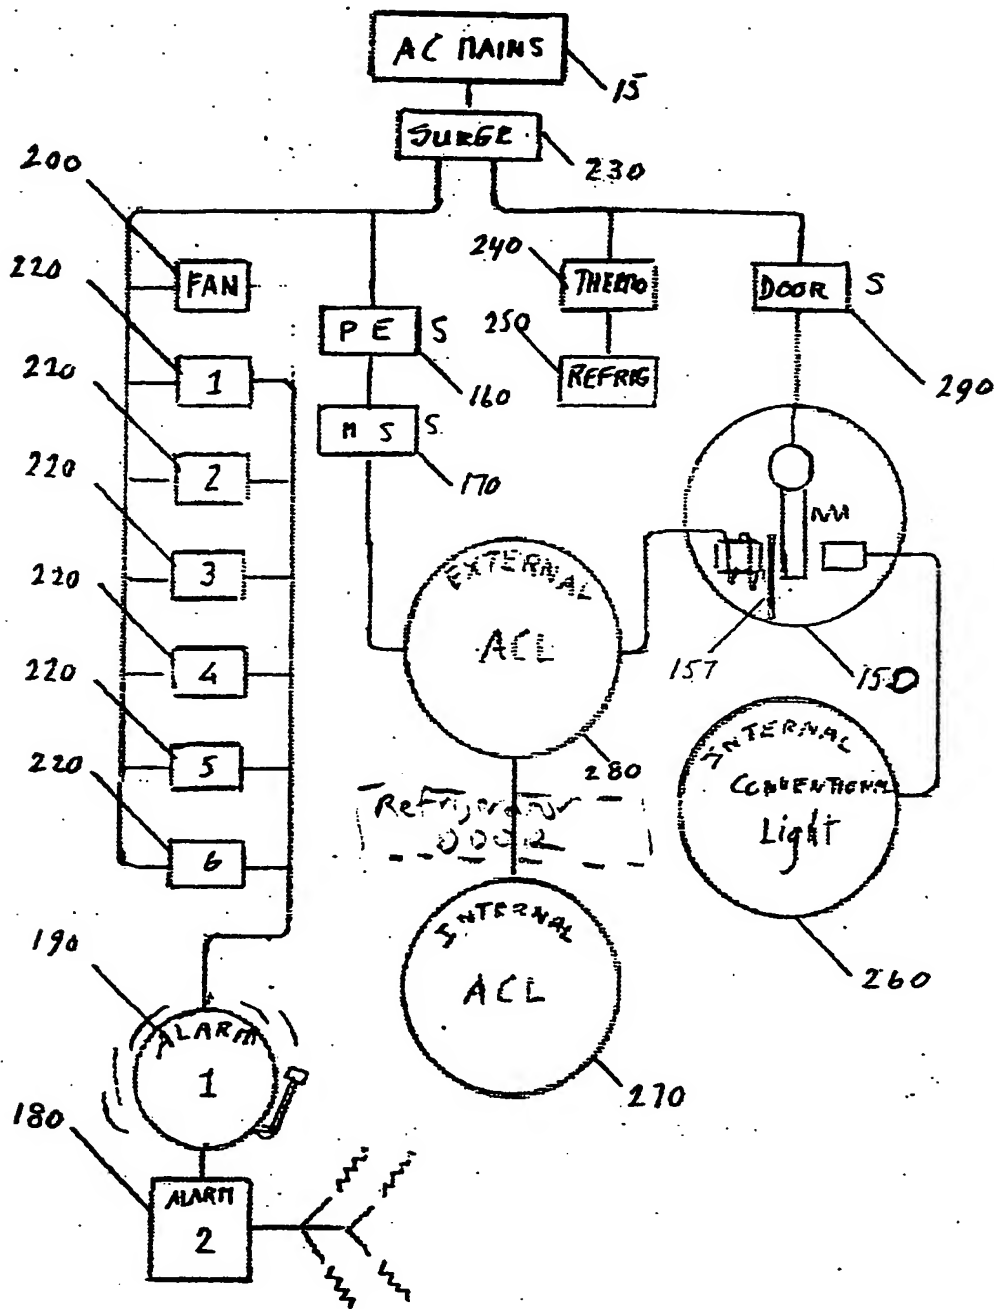


Fig. 5 Anti-Carcinogenic<sup>TM</sup>  
Clock/Watch

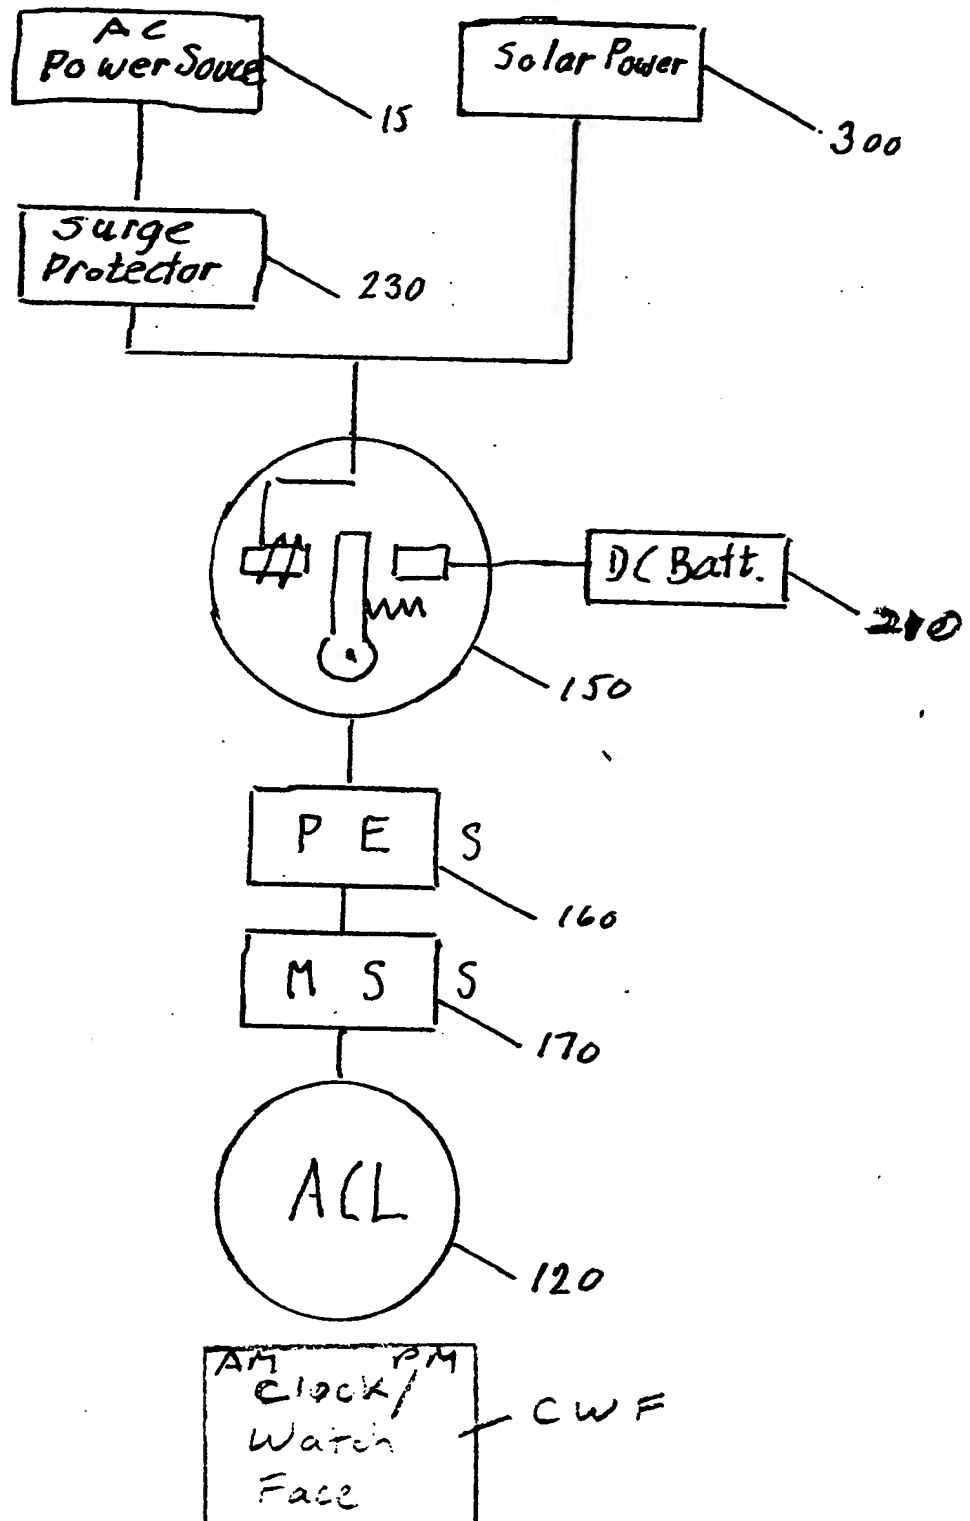

# Fig. 6 Anti-Carcinogenic™ Conversion Unit

Fig. 6A

Fig. 6

